

CLASSIC DOUBLE FIRE RATED

DOUBLE FD30 POCKET DOORS SYSTEM



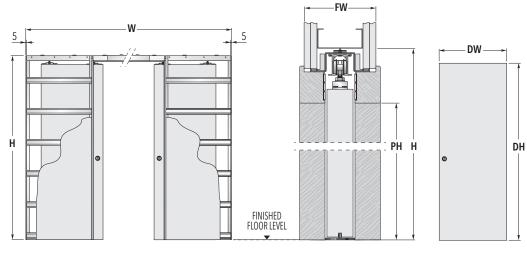

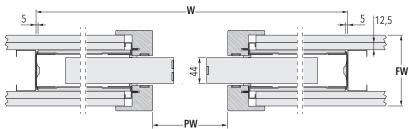

PLEASE NOTE INBUILT TOLERANCE

If setting out your studwork before delivery of your frame please note there is approximately an 8mm tolerance built into the height of these pocket door systems which you will need to take into account. Packers may be required to accommodate for this gap if you are unable to adjust the studwork above the system.

Note: Frame should be installed at finished floor level.

| FRAMES FOR DOUBLE DOORS | | | DOOR PANEL UK | |
|-------------------------|-------------------|---------------|---------------------------------------|------|
| MAX. PASSAGE SIZE | OVERALL DIMENSION | FINISHED WALL | | |
| PW x PH | W×H | FW | DW | DH |
| 1180 x 2020 | 2494 x 2120 | 120 | 626 | 2040 |
| 1380 x 2020 | 2894 x 2120 | 120 | 726 | 2040 |
| 1580 x 2020 | 3294 x 2120 | 120 | 826 | 2040 |
| 1780 x 2020 | 3694 x 2120 | 120 | 926 | 2040 |
| 1980 x 2020 | 4094 x 2120 | 120 | 1026 | 2040 |
| 1150 x 1960 | 2464 x 2061 | 120 | 2ft. 0in. x 6ft. 6in. (610 x 1981 mm) | |
| 1302 x 1960 | 2816 x 2061 | 120 | 2ft. 3in. x 6ft. 6in. (686 x 1981 mm) | |
| 1454 x 1960 | 3168 x 2061 | 120 | 2ft. 6in. x 6ft. 6in. (762 x 1981 mm) | |
| 1606 x 1960 | 3320 x 2061 | 120 | 2ft. 9in. x 6ft. 6in. (838 x 1981 mm) | |
| 1780 x 1960 | 3694 x 2061 | 120 | 3ft. 0in. x 6ft. 6in. (914 x 1981 mm) | |

Dimensions are given in mm



NOTES

- ► Suitable for use with 44 mm thick FD30 timber doors (not supplied)
- ▶ Supplied with special jambs with integrated architrave.
- ► Max. door weight 100 kg.
- ▶ FD30 door and fireboard not supplied.
- ▶ Install at finished floor level.
- ▶ Self centering floor guide with anti-warp profile.
- ► Finished wall thickness 120 mm (frame thickness 70 mm).
- ► Intumescent strips included.
- ▶ Use two layers of 12.5 mm fireboard each side (not supplied).



ACCESSORIES

► Self Closing Mechanism*

Open the door and it closes by itself

BIAS®

Soft close anti-slam device with 40 kg soft closing

* Please check first with your Building Inspector prior to ordering to determine whether or not your particular project will require a self-closing mechanism.



INTERNATIONAL FIRE CONSULTANTS GROUP

The system was tested to BS EN 1634-1:2008 for fire resistance at Cambridge Fire Research which is an independent UKAS accredited testing laboratory.